



Certificate of Conformity

Certification Body:



SAI Global Certification Services Pty Limited

(ACN 108 716 669) Operating as "Intertek & Intertek SAI Global"

JAS-ANZ Accreditation No. Z1440295AS

Address: Level 7 Suite 7.01. 45 Clarence Street, Sydney NSW 2000 Australia

Website: www.saiglobal.com



Certificate Holder:

CSR Building Products Limited (Trading as CSR Cemintel)

Trinity 3, 39 Delhi Road, North Ryde, NSW, 2113, Australia
Phone: 1800 633 826

Website: <https://www.csr.com.au/About-Us/Contact-Us>

SAI Global Certification Services

Calin Moldovean
President, Business Assurance
SAI Global Assurance

James Deters – Unrestricted Building Certifier

Certificate number: CM20199

THIS TO CERTIFY THAT

CEMINTEL Surround® Wall Cladding System

Type and/or use of product:

CEMINTEL Surround® is an external wall cladding system for residential and commercial buildings. Suitable for use on all buildings where metal top hats can be fixed either to steel stud framing, timber stud framing, or to masonry and concrete substrates.

For Class 2 to Class 9 buildings, CEMINTEL Surround® wall cladding system is suitable for only Type C Fire-Resisting Construction when fixed to timber stud framing.

CEMINTEL Surround® panels are also used as internal wall lining.

Description of product:

CEMINTEL Surround® panels are prefinished, fibre cement panels trimmed and sealed in a standard 1200mm x 3000mm x 8mm. The panels are colour bodied and available in a range of colours and textures featuring a matte finish.

The wall system components & accessories are detailed in the CEMINTEL SURROUND® EXTERNAL-Design & Installation Guide 01/2024 REV 01 and for internal applications CEMINTEL SURROUND® SERIES – Internal Installation 07/2023.

COMPLIES WITH THE FOLLOWING BCA PROVISIONS AND STATE OR TERRITORY VARIATION(S)

BCA 2022

	Volume One		Volume Two and ABCB Housing Provisions	
Performance Requirement(s)	B1P1(1) limited to (2)(a) & (c) F3P1	Structural reliability (limited to self-weight and wind actions) Weatherproofing	H1P1(1) limited to (2)(a) & (c) H2P2	Structural stability and resistance (limited to self-weight and wind actions) Weatherproofing
Deemed-to-Satisfy Provision(s):	C2D2 including Specification 5 (as applicable)	Fire resistance and stability – Type of construction required (FRL 120/120/120, or -/180/180 when used in a system with Fyrchek® MR plasterboard, refer	H3D2(1)(a) & (d) H3D3 and Clause 9.2.3(2)(a) of	General concession — Materials may be used wherever a non-combustible material is required Fire separation of external walls – Construction of external walls (FRL 60/60/60 when used in a system with

Date of issue: 01 May 2024

Date of expiry: 26 February 2026



Certificate of Conformity

		below to Section A3 "A3 Product specification" of this certificate)	ABCB Housing Provisions	Fyrchek® MR plasterboard, refer below to Section A3 of this certificate)
	C2D10(6)(a) & (d)	General concession – Materials may be used wherever a non-combustible material is required	H7D4(2)(a)	Construction in bushfire-prone areas (refer to Limitations and conditions below)
	C2D11(1)(b) including Specification 7 Clause S7C4	Fire resistance and stability – Fire hazard properties		
	G5D3	Construction in bushfire-prone areas – Protection — residential buildings (refer to Limitations and conditions below)		
State or territory variation(s):	SA C2D2	Fire resistance and stability – Type of construction required	NSW H7D4	Construction in bushfire-prone areas (refer to Limitations and conditions below)
	NSW C2D11	Fire resistance and stability – Fire hazard properties		
	NSW G5D3	Construction in bushfire-prone areas – Protection — residential buildings (refer to Limitations and conditions below)		

SUBJECT TO THE FOLLOWING LIMITATIONS AND CONDITIONS AND THE PRODUCT TECHNICAL DATA IN APPENDIX A AND EVALUATION STATEMENTS IN APPENDIX B

Limitations and conditions:

1. CEMINTEL Surround[®] Wall Cladding System with Fyrchek[®] MR Plasterboard can be used where the required Fire Resistance Levels (FRLs) does not exceed 120/120/120 or -/180/180 as specified in the NCC 2022 BCA Volume One Specification 5. The installation must be in accordance with the relevant details contained within the System Engineering section of CEMINTEL SURROUND[®] EXTERNAL-Design & Installation Guide 01/2024 REV 01 and system specifications details shown below in section "A3 Product specification".
2. For Class 2 to Class 9 buildings, CEMINTEL Surround[®] Wall Cladding System is suitable for only Type C Fire-Resisting Construction when fixed to timber stud framing.
3. For Type C Fire-Resisting Construction, CEMINTEL Surround[®] Wall Cladding System has not been assessed against the requirements of Specification 5 Clause S5C24(1)(c) of a fire wall or an internal wall bounding a sole-occupancy unit or separating adjoining units.
4. CEMINTEL Surround[®] when used as an internal wall lining achieved a Group Number 1 and Smoke Growth Rate Index (SMOGR_{RC} 0.2 m²s⁻²x1000) as determined in accordance with AS 5637.1:2015.
5. The following were the only wall wraps assessed against the requirements of C2D10(6)(f) for sarking-type material:
 - a) Bradford Thermosteal[®] Wall Wrap.
 - b) Bradford Thermosteal[®] Firespec Wall Wrap.
 - c) Enviroseal Commercial Wall (CW).
 - d) Enviroseal Residential Wall (RW).
 - e) Enviroseal Residential Wall Plus (RW Plus)Other wall wraps may also be used provided they comply with the requirements of C2D10(6)(f) for sarking type materials.
6. The following were the only insulations assessed against the requirements of C2D10(1) for non-combustible building elements:
 - a) 75 Gold Batts R1.5 at 8.76kg/m³ density.
 - b) 75 Gold Batts R2.0 at 17.3kg/m³ density.
 - c) 90 Gold Batts R2.0 at 10.4kg/m³ density.
 - d) 90 Gold Batts R2.5 at 20.5kg/m³ density.
 - e) 90 Gold Batts R2.7 at 33.1kg/m³ density.

Building classification/s:

- Volume 1 – Class 2 to Class 9 buildings
Volume 2 – Class 1 and Class 10(a) buildings

7. CEMINTEL Surround® Wall Cladding System shall be used for its intended purpose. For further information on limited applications of the product, refer to the following Cemintel Surround® guides as relevant:
 - a) CEMINTEL SURROUND® EXTERNAL-Design & Installation Guide 01/2024 REV 01
 - b) CEMINTEL SURROUND® SERIES – Internal Installation 07/2023.
8. CEMINTEL Surround® Wall Cladding System has been tested to the requirements of AS/NZS 4284:2018 in accordance with the NCC verification methods and has been determined to achieve compliance with F3P1 and H2P2 when installed as a pressure equalised system in applications where an external wall of the building also:
 - a) has a risk score of 20 or less determined in accordance with Table F3V1a or H2V1a, of the BCA, as appropriate; and
 - b) has a maximum Design Ultimate Limit State wind pressure of ± 2.5 kPa using the Cemintel soft air barrier system incorporating Enviroseal CW-IT wall wrap; and
 - c) has a maximum Design Serviceability Limit State wind pressure of +2.5 kPa using a Cemintel Rigid Air Barrier system (Cemintel 6mm thick fibre cement RAB sheet); and
 - d) has a maximum Design Serviceability Limit State wind pressure of +1.19 kPa and -1.79 kPa using Enviroseal CW when not detailed as an air barrier.

Other wall wraps may also be used, provided they have equivalent or better strength properties than Enviroseal CW / CW-IT when determined in accordance with AS/NZS 4200.1:2017.

9. CEMINTEL Surround® Wall Cladding System has been evaluated for use in all Australian wind zones up to and including N6 and Cyclonic C4 in accordance with AS 4055 and for ultimate wind pressures up to 7.0 kPa under AS/NZS 1170.2 including cyclonic zones when fixed to steel framing with Cemintel Rigid Air Barrier. Construction details and fixing must follow the relevant details contained within the System Engineering section of CEMINTEL SURROUND® EXTERNAL-Design & Installation Guide 01/2024 REV 01
10. CEMINTEL Surround® Wall Cladding System is not certified for either energy efficiency or acoustic performance.
11. CEMINTEL Surround® Wall Cladding System is suitable for use on buildings located in a designated Bushfire-Prone Area subject to a Bushfire Attack Level (BAL) up to and including BAL-29 when constructed in accordance with AS 3959:2018 (subject to state and territory variations) for a Class 1 building, a Class 2 building, a Class 3 building, or a Class 10a building or deck immediately adjacent or connected to such a building or part.

12. In NSW, CEMINTEL Surround[®] Wall Cladding System is suitable for use on buildings located in a designated Bushfire-Prone Area:
- a) For a Class 1 building, a Class 2 building, a Class 3 building, a Class 4 part of a building, or a Class 10a building or deck immediately adjacent or connected to such a building or part when constructed in accordance with AS 3959:2018 except as amended by Planning for Bush Fire Protection for BAL-29. Seek guidance from your appropriately qualified bushfire expert for additional consideration and assessment.
 - b) For a Class 9 buildings located in an area subject to a Bushfire Attack Level (BAL) not exceeding BAL-12.5 determined in accordance with AS 3959.
13. In VIC, CEMINTEL Surround[®] Wall Cladding System is suitable for use on Class 9(a) healthcare buildings, Class 9(b) early childhood or school buildings, Class 9(c) residential care buildings or Class 4 parts of buildings associated with the preceding classifications that are in designated bushfire prone areas subject to a Bushfire Attack Level (BAL) not exceeding BAL-12.5 determined in accordance with AS 3959:2018.
14. All flashing including inter-storey junction must be metal flashing.

Scope of certification: The CodeMark Scheme is a building product certification scheme. The rules of the Scheme are available at the ABCB website www.abcb.gov.au. This Certificate of Conformity is to confirm that the relevant requirements of the Building Code of Australia (BCA) as claimed against have been met. The responsibility for the product performance and its fitness for the intended use remain with the certificate holder. The certification is not transferrable to a manufacturer not listed on Appendix A of this certificate.

Disclaimer: The Scheme Owner, Scheme Administrator and Scheme Accreditation Body do not make any representations, warranties or guarantees, and accept no legal liability whatsoever arising from or connected to, the accuracy, reliability, currency or completeness of any material contained within this certificate; and the Scheme Owner, Scheme Administrator and Scheme Accreditation Body disclaim to the extent permitted by law, all liability (including negligence) for claims of losses, expenses, damages and costs arising as a result of the use of the product(s) referred to in this certificate.

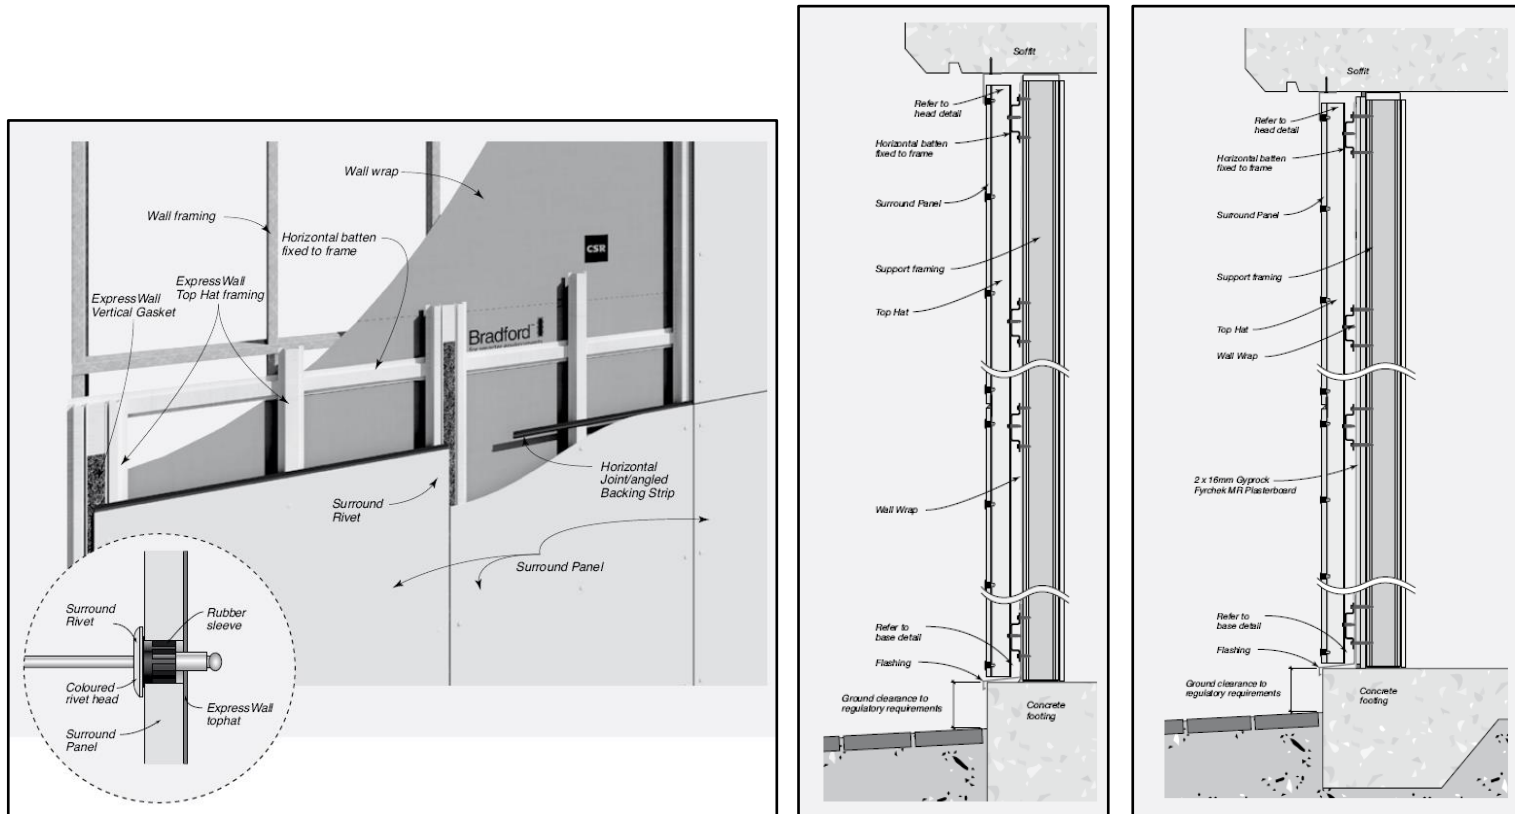
APPENDIX A – PRODUCT TECHNICAL DATA

A1 Type and intended use of product

Refer to Page 1 of this certificate.

A2 Description of product

Refer to Page 1 of this certificate and the below diagrams.





Certificate of Conformity


A3 Product specification


Below are some physical properties of fibre cement and system specifications.

PANEL - DIMENSIONAL & GEOMETRICAL CHARACTERISTICS			
Dimensional/Geometrical Characteristic	Specification	Manufacturing Tolerance	Relevant Standard
Panel Width	1200mm	+/- 1.5mm	
Panel Length	3000mm	+/- 1.5mm	
Panel Thickness	8mm	+/- 0.8mm	
Profile	Square Edge		
Perpendicularity/squareness of edges		<1mm/m	
Weight (typical)	15.7kg/m ² Based on dry weight		
Layout Options	Horizontal, Vertical, Curved (refer to Designlink for custom solution)		
Jointing	Expressed		


Certificate of Conformity


The following System Specification tables are extracts from Section F – External Wall Systems pages F13, F14, F28, and F29 of the GYROCK® THE RED BOOK® 1 publication.

SYSTEM SPECIFICATIONS			Cemintel ExpressWall – With Cavity – Steel Frame		F13			
 <p>Cemintel ExpressPanel, Barestone or Surround system.</p> <p>Wall wrap or 6mm Cemintel Rigid Air Barrier.</p> <p>15mm top hat.</p> <p>Lining material as per system table to external side.</p> <p>Steel studs at 600mm maximum centres.</p> <p>Cavity insulation as per system table.</p> <p>Lining material as per system table to internal side.</p> <p>NOTE: Acoustic performance valid for studs with 0.75 BMT. The system thermal R-values provided have been calculated based on a thermal transmission path through the wall cavity and does not allow for the effects of thermal bridging.</p>								
SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119					
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm		70		90	
			CAVITY INFILL (Refer to TABLE B6)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	
- / - / -	CSR 5327	EXTERNAL WALL SIDE • Nil INTERNAL WALL SIDE • 1 x 13mm Gyprock Standard Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 48/39	- - 2.1/2.2	49/40 50/41 49/40	2.1/2.3 2.6/2.8 2.3/2.4	
		Min. Wall Thickness mm		141		161		
30/30/30 (from outside only) FC 12946	CSR 5332	EXTERNAL WALL SIDE • 1 x 13mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 1 x 10mm Gyprock Plus Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 42/31	- - 2.1/2.3	43/32 44/33 43/32	2.2/2.4 2.6/2.9 2.3/2.5	
		Min. Wall Thickness mm		151		171		
30/30/30 (from outside only) FC 12946	CSR 5340	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 1 x 6mm CemintSeal Wallboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 47/37	- - 2.1/2.2	48/38 49/39 48/38	2.2/2.4 2.6/2.9 2.3/2.5	
		Min. Wall Thickness mm		150		170		
60/60/60 (from outside only) FC 12946	CSR 5342	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 1 x 10mm Gyprock Plus Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 43/32	- - 2.1/2.3	44/33 45/34 44/33	2.2/2.4 2.6/2.9 2.3/2.5	
		Min. Wall Thickness mm		154		174		
60/60/60 (from outside only) FC 12946	CSR 5343	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 1 x 10mm Gyprock Aquachek Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 46/35	- - 2.1/2.3	47/36 48/37 47/36	2.2/2.4 2.6/2.9 2.3/2.5	
		Min. Wall Thickness mm		154		174		

SYSTEM SPECIFICATIONS			Cemintel ExpressWall – With Cavity – Steel Frame		F14			
 <p>Cemintel ExpressPanel, Barestone or Surround system.</p> <p>Wall wrap or 6mm Cemintel Rigid Air Barrier.</p> <p>15mm top hat.</p> <p>Lining material as per system table to external side.</p> <p>Steel studs at 600mm maximum centres.</p> <p>Cavity insulation as per system table.</p> <p>Lining material as per system table to internal side.</p> <p>NOTE: Acoustic performance valid for studs with 0.75 BMT. The system thermal R-values provided have been calculated based on a thermal transmission path through the wall cavity and does not allow for the effects of thermal bridging. ‡ Unique height restrictions apply. Refer to The Red Book 3, height selection tables.</p>								
SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119					
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm		70		90	
			CAVITY INFILL (Refer to TABLE B6)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	
60/60/60 - /90/90 (from both sides) FC 12946	CSR 5345	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 49/39	- - 2.2/2.3	50/40 51/41 50/40	2.2/2.4 2.6/2.9 2.4/2.6	
		Min. Wall Thickness mm		160		180		
90/90/90 (from outside only) FC 12946	CSR 5346	EXTERNAL WALL SIDE • 2 x 13mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 1 x 10mm Gyprock Plus Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 47/36	- - 2.2/2.3	48/37 49/38 48/37	2.2/2.4 2.6/2.9 2.4/2.6	
		Min. Wall Thickness mm		164		184		
120/120/120 (from outside only) FC 12946	CSR 5347	EXTERNAL WALL SIDE • 2 x 16mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 1 x 10mm Gyprock Plus Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 48/37	- - 2.2/2.4	49/38 50/39 49/38	2.2/2.4 2.6/2.9 2.4/2.6	
		Min. Wall Thickness mm		170		190		
120/120/120 - /180/180‡ (from both sides) FC 12946	CSR 5349	EXTERNAL WALL SIDE • 2 x 16mm Gyprock Fyrchek MR Plasterboard. INTERNAL WALL SIDE • 2 x 16mm Gyprock Fyrchek Plasterboard.	(b) 90 Gold Batts R2.0 (c) 90 Gold Batts R2.5 (d) 75 Gold Batts R2.0	- - 54/45	- - 2.3/2.5	55/46 56/47 55/46	2.2/2.4 2.6/2.9 2.6/2.7	
		Min. Wall Thickness mm		194		212		

Certificate of Conformity

SYSTEM SPECIFICATIONS			Cemintel ExpressWall – With Cavity – Timber Frame						F28	
 <p>Cemintel ExpressPanel, Barestone or Surround system.</p> <p>Timber studs at 600mm maximum centres.</p> <p>Wall wrap.</p> <p>Lining material as per system table to external side.</p> <p>Cavity insulation as per system table.</p> <p>Lining material as per system table to internal side.</p>			<p>NOTE: Acoustic performance valid for 35mm wide studs at 600mm centres. The system thermal R-values provided have been calculated based on a thermal transmission path through the wall cavity and does not allow for the effects of thermal bridging. *ACR = Axial Capacity Reduction.</p>							
SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119							
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm		70		90			
			CAVITY INFILL (Refer to TABLE B6)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	
30/30/30 (from outside only) FC 12969	CSR 5851	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	46/36	2.2/2.4			
		INTERNAL WALL SIDE • 1 x 6mm CeminiSeal Wallboard.	(c) 90 Gold Batts R2.5	–	–	47/37	2.6/2.9			
			(d) 75 Gold Batts R2.0	45/35	2.1/2.2	46/36	2.3/2.5			
			Min. Wall Thickness mm	135		155				
30/30/30 (from both sides) FC 12969	CSR 5854	EXTERNAL WALL SIDE • 1 x 13mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	45/34	2.2/2.4			
		INTERNAL WALL SIDE • 1 x 13mm Gyprock Fyrchek Plasterboard.	(c) 90 Gold Batts R2.5	–	–	46/35	2.6/2.9			
			(d) 75 Gold Batts R2.0	44/33	2.1/2.3	45/34	2.3/2.5			
			Min. Wall Thickness mm	139		159				
90/90/90 (from outside only) FC 12969	CSR 5857	EXTERNAL WALL SIDE • 2 x 13mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	46/35	2.2/2.4			
		INTERNAL WALL SIDE • 1 x 10mm Gyprock Plus Plasterboard.	(c) 90 Gold Batts R2.5	–	–	47/36	2.6/2.9			
			(d) 75 Gold Batts R2.0	45/34	2.2/2.3	46/35	2.4/2.6			
			Min. Wall Thickness mm	149		169				
60/60/60* (from outside only) *ACR Group 2 FC 12969	CSR 5860	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	43/32	2.2/2.4			
		INTERNAL WALL SIDE • 1 x 10mm Gyprock Plus Plasterboard.	(c) 90 Gold Batts R2.5	–	–	44/33	2.6/2.9			
			(d) 75 Gold Batts R2.0	42/31	2.1/2.3	43/32	2.3/2.5			
			Min. Wall Thickness mm	139		159				
60/60/60* (from outside only) *ACR Group 2 FC 12969	CSR 5862	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	45/34	2.2/2.4			
		INTERNAL WALL SIDE • 1 x 10mm Gyprock Aquachek Plasterboard.	(c) 90 Gold Batts R2.5	–	–	46/35	2.6/2.9			
			(d) 75 Gold Batts R2.0	44/33	2.1/2.3	45/34	2.3/2.5			
			Min. Wall Thickness mm	139		159				

SYSTEM SPECIFICATIONS			Cemintel ExpressWall – With Cavity – Timber Frame						F29	
 <p>Cemintel ExpressPanel, Barestone or Surround system.</p> <p>Timber studs at 600mm maximum centres.</p> <p>Wall Wrap.</p> <p>Lining material as per system table to external side.</p> <p>Cavity insulation as per system table.</p> <p>Lining material as per system table to internal side.</p>			<p>NOTE: Acoustic performance valid for 35mm wide studs at 600mm centres. The system thermal R-values provided have been calculated based on a thermal transmission path through the wall cavity and does not allow for the effects of thermal bridging. *ACR = Axial Capacity Reduction.</p>							
SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119							
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm		70		90			
			CAVITY INFILL (Refer to TABLE B6)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	R _w / R _w +C _{tr}	R _t (sum) / R _t (win)	
60/60/60 (from both sides) FC 12969	CSR 5865	EXTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	47/37	2.2/2.4			
		INTERNAL WALL SIDE • 1 x 16mm Gyprock Fyrchek Plasterboard.	(c) 90 Gold Batts R2.5	–	–	48/38	2.6/2.9			
			(d) 75 Gold Batts R2.0	46/36	2.2/2.3	47/37	2.4/2.6			
			Min. Wall Thickness mm	145		165				
120/120/120 (from outside only) FC 12969	CSR 5872	EXTERNAL WALL SIDE • 2 x 16mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	47/36	2.2/2.4			
		INTERNAL WALL SIDE • 1 x 10mm Gyprock Plus Plasterboard.	(c) 90 Gold Batts R2.5	–	–	48/37	2.6/2.9			
			(d) 75 Gold Batts R2.0	46/35	2.2/2.4	47/36	2.4/2.6			
			Min. Wall Thickness mm	155		175				
120/120/120 (from both sides) FC 12969	CSR 5874	EXTERNAL WALL SIDE • 2 x 16mm Gyprock Fyrchek MR Plasterboard.	(b) 90 Gold Batts R2.0	–	–	52/43	2.2/2.4			
		INTERNAL WALL SIDE • 2 x 16mm Gyprock Fyrchek Plasterboard.	(c) 90 Gold Batts R2.5	–	–	53/44	2.6/2.9			
			(d) 75 Gold Batts R2.0	51/42	2.3/2.5	52/43	2.6/2.7			
			Min. Wall Thickness mm	177		197				



Certificate of Conformity

A4 Manufacturer and manufacturing plant(s)

A5 Installation requirements

Refer to Page 3 of this certificate and the following:

- CEMINTEL SURROUND® EXTERNAL-Design & Installation Guide 01/2024 REV 01
- CEMINTEL SURROUND® SERIES – Internal Installation 07/2023.

A6 Other relevant technical data

- Technical Datasheets for Bradford Thermoseal® Wall Wrap, Bradford Thermoseal® Firespec Wall Wrap, Enviroseal ProctorWrap (CW/CW-IT) Wall Wrap, and Enviroseal ProctorWrap (RW) Wall Wrap with nominal thickness <1.0mm for all products.
- Technical Datasheet for Bradford Acoustigard partition rolls.

APPENDIX B – EVALUATION STATEMENTS

B1 Evaluation methods

The system has been assessed as complying with the identified Performance Requirements of the NCC 2022 BCA Volumes 1 and 2. This involved a review of product specifications, test reports, installation manuals, and associated documentation.

1. Structural assessment:

- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Cyclone Testing Station, James Cook University (NATA accreditation No. 14937)
- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(e) – A report from a professional engineer (David Beneke Consulting).

2. Weatherproofing assessment:

- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Ian Bennie and Associates (NATA accreditation No. 2371)
- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(e) – A report from an appropriately qualified person (XAVIER KNIGHT).

3. Fire Resistance assessment:

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – An assessment report issued by an Accredited testing Laboratory – BRANZ Ltd (IANZ accreditation No. 37).

4. Non-Combustibility assessment:

A. Surround Fibre Cement (General Concessions)

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(f) – Another form of documentary evidence – by exemption/product specification.

B. Sarking-type material

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Insulation Research Laboratory (NATA accreditation No. 993).
- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – AWTA Product Testing (NATA accreditation No. 1356).

C. Insulation material

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Insulation Research Laboratory (NATA accreditation No. 993).
- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(e) – An assessment report from an appropriately qualified person – CSIRO.

5. Fire Hazard Properties assessment:

- Volume 1 – A2G3(2)(a)/A5G3(1)(e) – An assessment report from an appropriately qualified person – Warringtonfire Australia Pty Ltd.

6. Construction in Bushfire Prone Areas assessment:

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(f) – Another form of documentary evidence (assessment against specifications in the referenced document – AS 3959:2018).

B2 Reports

Evaluation methods	Related Supporting Evidence as listed below
Structural Assessment	Numbers 1 – 2
Weatherproofing Assessment	Numbers 3 – 5
Fire Resistance assessment	Numbers 6 – 7
Non-Combustibility	Numbers 8 – 17
Fire Hazard Properties assessment	Number 18
Resistance to Bushfire Construction assessment	Number 19

Structure

- David Beneke Consulting, Engineering Report for Certification of CSR Cemintel Surround Façade System, Report No. 2013-28-LO-167 Revision 5 (dated 18 March 2023).**
This document certifies the maximum top hat spans and spacings of ExpressWall façade system with Surround™ panels in accordance with normal engineering practice and principals, test methods and the relevant Australian Standards.
- Cyclone Testing Station, James Cook University, Connection Testing, Cyclic Simulated Wind Load Strength Testing, and Assessment of the Cyclic Wind Load Capacity of CSR Cemintel Creative Façade System, Report No. TS1055 Revision A (dated: 26 April 2017).**
This document contains the test results of a Cemintel Creative Façade (8mm & 9mm nominal thickness) and connection testing for resistance to simulated cyclic wind load, carried out in accordance with AS 4040.3.

Weatherproofing

- Ian Bennie and Associates, Test Report for Air Infiltration, Water Penetration and Structural of Cemintel Creative Façade System, Report No. 2016-108-S1-R3 (updated 31 October 2023).**
This document contains the test results of the Cemintel Creative Façade System for Structural SLS, Air Infiltration, Water Penetration, and Structural ULS carried out in accordance with AS/NZS 4284:2008.
- Ian Bennie and Associates, Test Report for Ultimate Load Capacity, Report No. 2016-066-S2 (dated 8 November 2016).**
This document contains the test results of Bradford Enviroseal ProctorWrap CW-IT without external cladding to determine the ultimate load capacity (Structural ULS) of the wrap alone carried out in accordance with AS/NZS 4284:2008.

5. **XAVIER KNIGHT, Weatherproofing Assessment for Cemintel Expressed Joint External Wall Systems (Surround, Barestone, ExpressPanel), XK230919 Revision 03 (dated 19 September 2023).**

This document confirms the compliance of this product with AS 4284:2008, based on the test results of Report Nos. 2016-108-S1 & 2016-066-S2, by Ian Bennie and Associates.

Fire Resistance

6. **BRANZ, Assessment Report for Fire Resistance of CSR Steel Framed Wall Systems, Report No. FC12946-01-08 Issue 8 (dated: 23 February 2023).**
This document contains the fire assessment results of the CSR steel framed system for resistance to fire, carried out in accordance with AS 1530.4:2014.
7. **BRANZ, Assessment Report for Fire Resistance of CSR Timber Framed Walls, Report No. FC12969-01 Issue 2 (dated: 5 October 2022).**
This document contains the fire assessment results of the CSR timber framed system for resistance to fire, carried out in accordance with AS 1530.4:2014.

Non-Combustibility

A. Sarking-type material

8. **CSR Insulation Research Laboratory, Test Report for Flammability Index Assessment of Bradford Thermoseal[®] Wall Wrap, Test Report NR-17201 (dated: 1 May 2017).**
This test report provides the test results of testing Bradford Thermoseal[®] Wall Wrap to AS 1530.2:1993 and returned a result of Flammability Index 1.
9. **AWTA Product Testing, Test Report for Flammability Index of Enviroseal ProctorWrap (RW) Wall Wrap, Test No. 22-001559 (dated: 25 May 2022).**
This test report provides the test results of testing ProctorWrap residential wall (RW) to AS 1530.2:1993 and returned a result of Flammability Index 1.
10. **AWTA Product Testing, Test Report for Flammability Index of Enviroseal (RW Plus) Wall Wrap, Test No. 21-002455 (dated: 28 May 2021).**
This test report provides the test results of testing Enviroseal (RW Plus) to AS 1530.2:1993 and returned a result of Flammability Index 1.
11. **AWTA Product Testing, Test Report for Flammability Index of Enviroseal ProctorWrap (CW) Wall Wrap, Test No. 22-001560 (dated: 20 May 2022).**
This test report provides the test results of testing ProctorWrap commercial wall (CW) to AS 1530.2:1993 and returned a result of Flammability Index 1.
12. **CSR Insulation Research Laboratory, Test Report for Flammability Index Assessment of Bradford Thermoseal[®] Firespec Wall Wrap, Test Report NR-16213 (dated: 20 December 2016).**
This test report provides the test results of testing Bradford Thermoseal[®] Firespec Wall Wrap to AS 1530.2:1993 and returned a result of Flammability Index 0.

B. Insulation

13. CSIRO, Assessment Report for combustibility of Bradford Glasswool insulation batts, Assessment Number FCO-2812/4643 Revision B (dated: 16 December 2019).

This report provides an assessment of Bradford Glasswool insulation batts (density range of 6.3kg/m³ to 26.8kg/m³) and determined the product was not deemed combustible when tested to the requirements of AS 1530.1:1994.

14. CSR Insulation Research Laboratory, Combustibility Test of CSR Bradford Gold, Report No. NR-18006 (dated: 13 August 2018).

This report contains the results of testing 90mm CSR Bradford Gold® R2.5 Wall Battis (mean density 20.5kg/m³) to EN ISO1182/AS 1530.1 and determined the product was not deemed combustible when tested to the requirements of AS 1530.1:1994.

15. CSR Insulation Research Laboratory, Combustibility Test of CSR Bradford Gold, Report No. NR-18007 (dated: 28 August 2018).

This report contains the results of testing 90mm CSR Bradford Gold® R2.0 Wall Battis (mean density 10.4kg/m³) to EN ISO1182/AS 1530.1 and determined the product was not deemed combustible when tested to the requirements of AS 1530.1:1994.

16. CSR Insulation Research Laboratory, Combustibility Test of CSR Bradford Gold, Report No. NR-20004 (dated: 11 September 2020).

This report contains the results of testing 75mm CSR Bradford Gold® R2.0 Wall Battis (mean density 17.3kg/m³) to EN ISO1182/AS 1530.1 and determined the product was not deemed combustible when tested to the requirements of AS 1530.1:1994.

17. CSR Insulation Research Laboratory, Combustibility Test of CSR Bradford Gold, Report No. NR-22112 (dated: 28 July 2022).

This report contains the results of testing 90mm CSR Bradford Gold® R2.7 Wall Battis (mean density 33.11kg/m³) and determined the product was not deemed combustible when tested to the requirements of AS 1530.1:1994.

Fire Hazard Properties

18. Warringtonfire, Assessment Report for Group Number and Smoke Growth Rate Index (SMOGRARC), Report No. 45759 Revision 12 (dated 26 October 2022).

This report shows the assessment undertaken to determine the likely fire hazard properties of the CSR wall and ceiling lining products and determined CSR plasterboard products are likely to achieve Group 1 classification and $SMOGR_{ARC} \leq 0.5m^2/s^2 \times 1000$ and CSR Cemintel fibre cement panels (including 8mm Surround) are likely to achieve Group 1 classification and $SMOGR_{ARC} \leq 0.2m^2s^{-2} \times 1000$ if tested in accordance with AS ISO 9705:2003 (R2016) and assessed in accordance with AS5637.1:2015.

Resistance to Bushfire Attack

19. Cemintel® Product Guide for Bushfire-Prone Areas (dated November 2023).

This guide provides information on Cemintel® wall cladding products and systems to meet the requirements of each BAL when assessed against specifications in AS 3959:2018.