



# Certificate of Conformity

## Certification Body:



SAI Global Certification Services Pty Limited  
(ACN 108 716 669) Operating as  
"Intertek & Intertek SAI Global"  
JAS-ANZ Accreditation No. Z1440295AS  
Address: Level 7 Suite 7.01. 45 Clarence Street, Sydney NSW 2000 Australia

Website: [www.saiglobal.com](http://www.saiglobal.com)



## Certificate Holder:

CSR Building Products Limited  
(Trading as CSR Cemintel)  
Trinity 3, 39 Delhi Road,  
North Ryde, NSW, 2113, Australia  
Phone: 1800 633 826  
Website:  
<https://www.csr.com.au/About-Us/Contact-Us>

Certificate number: CM20199 Rev 03

### THIS TO CERTIFY THAT

## CEMINTEL Surround® Wall Cladding System

### Type and/or use of product:

CEMINTEL Surround® is an external wall cladding system for residential and commercial buildings. Suitable for use on all buildings where metal top hats can be fixed either to steel stud framing, or to masonry and concrete substrates. (Type A, B & C construction)

For Class 2 to Class 9 buildings, CEMINTEL Surround® wall cladding system is suitable for only Type C Fire-Resisting Construction when fixed to timber stud framing.

CEMINTEL Surround® panels are also used as internal wall lining.

### Description of product:

CEMINTEL Surround® panels are prefinished, fibre cement panels trimmed and sealed in a standard 1200mm x 3000mm x 8mm. The panels are colour bodied and available in a range of colours and textures featuring a matte finish.

The wall system components & accessories are detailed in the CEMINTEL SURROUND® EXTERNAL-Design & Installation Guide 02/2026 and for internal applications CEMINTEL SURROUND® SERIES – Internal Installation 01/2026.

### COMPLIES WITH THE FOLLOWING BCA PROVISIONS AND STATE OR TERRITORY VARIATION(S)

## BCA 2022 Amdt 2

	Volume One		Volume Two and ABCB Housing Provisions	
<b>Performance Requirement(s)</b>	<b>B1P1(1) limited to (2)(a) &amp; (c)</b>	<b>Structural reliability</b> (limited to self-weight and wind actions)	<b>H1P1(1) limited to (2)(a) &amp; (c)</b>	<b>Structural stability and resistance</b> (limited to self-weight and wind actions)
	<b>F3P1</b>	<b>Weatherproofing</b>	<b>H2P2</b>	<b>Weatherproofing</b>
<b>Deemed-to-Satisfy Provision(s):</b>	<b>C2D2 including Specification 5 (as applicable)</b>	<b>Fire resistance and stability</b> – Type of construction required (FRL 120/120/120, or -/180/180 when used in a system with Fyrchek® MR plasterboard, refer below to Section A3 "A3 Product specification" of this certificate)	<b>H3D2(1)(a) &amp; (d)</b>	<b>General concession</b> — Materials may be used wherever a non-combustible material is required
			<b>H3D3 and Clause 9.2.3(2)(a) of</b>	<b>Fire separation of external walls</b> – Construction of external walls (FRL 60/60/60 when used in a system with

Mark Thomas  
Executive Vice President,  
Assurance, Sustainability, AgriWorld & Food

Harley Parkes – Unrestricted Building Certifier

Date of issue: 26 February 2026

Date of expiry: 26 February 2029



# Certificate of Conformity

**State or territory variation(s):**

<b>C2D10(6)(a) &amp; (d)</b>	<b>General concession</b> – Materials may be used wherever a non-combustible material is required	<b>ABCB Housing Provisions</b>	Fyrchek <sup>®</sup> MR plasterboard, refer below to Section A3 of this certificate)
<b>C2D11(1)(b) including Specification 7 Clause S7C4</b>	<b>Fire resistance and stability</b> – Fire hazard properties	<b>H7D4(2)(a)</b>	<b>Construction in bushfire-prone areas</b> (refer to Limitations and conditions below)
<b>G5D3</b>	<b>Construction in bushfire-prone areas</b> – Protection — residential buildings (refer to Limitations and conditions below)		
<b>G5D4, limited to S43C10</b>	<b>Construction in bushfire-prone areas</b> – Protection — certain Class 9 buildings (refer to Limitations and conditions below)		
<b>SA C2D2</b>	<b>Fire resistance and stability</b> – Type of construction required	<b>NSW H7D4</b>	<b>Construction in bushfire-prone areas</b> (refer to Limitations and conditions below)
<b>NSW C2D11</b>	<b>Fire resistance and stability</b> – Fire hazard properties		
<b>NSW G5D3</b>	<b>Construction in bushfire-prone areas</b> – Protection — residential buildings (refer to Limitations and conditions below)		
<b>NSW G5D4, limited to S43C10</b>	<b>Construction in bushfire-prone areas</b> – Protection – Class 9 buildings used as a special fire protection purpose		
<b>VIC G5D4, limited to S43C10</b>	<b>Construction in bushfire-prone areas</b> – Protection — certain Class 9 buildings		

**SUBJECT TO THE FOLLOWING LIMITATIONS AND CONDITIONS AND THE PRODUCT TECHNICAL DATA IN APPENDIX A AND EVALUATION STATEMENTS IN APPENDIX B**

**Limitations and conditions:**

1. CEMINTEL Surround<sup>®</sup> Wall Cladding System with Fyrchek<sup>®</sup> MR Plasterboard can be used where the required Fire Resistance Levels (FRLs) does not exceed 120/120/120 or -/180/180 as specified in the NCC 2022 BCA Volume One Specification 5. The installation must be in accordance with the relevant details contained within the System Engineering section of CEMINTEL SURROUND<sup>®</sup> EXTERNAL-Design & Installation Guide 02/2026 and system specifications details shown below in section "A3 Product specification".
2. For Class 2 to Class 9 buildings, CEMINTEL Surround<sup>®</sup> Wall Cladding System is suitable for only Type C Fire-Resisting Construction when fixed to timber stud framing.
3. For Type C Fire-Resisting Construction, CEMINTEL Surround<sup>®</sup> Wall Cladding System has not been assessed against the requirements of Specification 5 Clause S5C24(1)(c) of a fire wall or an internal wall bounding a sole-occupancy unit or separating adjoining units.
4. CEMINTEL Surround<sup>®</sup> when used as an internal wall lining achieved a Group Number 1 and Smoke Growth Rate Index (SMOGR<sub>RC</sub> 0.2 m<sup>2</sup>s<sup>-2</sup>x1000) as determined in accordance with AS 5637.1:2015.
5. The following were the only wall wraps assessed against the requirements of C2D10(6)(f) for sarking-type material:
  - a) Bradford Thermoseal<sup>®</sup> Wall Wrap XP,
  - b) Bradford Thermoseal<sup>®</sup> Wall Wrap,
  - c) Bradford Thermoseal<sup>®</sup> Firespec,
  - d) Bradford Enviroseal CW/CW-IT Wall Wrap,
  - e) Bradford Enviroseal Plus Wall Wrap,
  - f) Bradford Enviroseal Aero Wall

Other wall wraps may also be used provided they comply with the requirements of C2D10(6)(f) for sarking type materials.

**Building classification/s:**

Volume 1 – Class 2 to Class 9 buildings  
Volume 2 – Class 1 and Class 10(a) buildings

# Certificate of Conformity

6. The following were the only insulations assessed against the requirements of C2D10(1) for non-combustible building elements:
  1. CSR Bradford Glasswool with heat-cured resin binder
    - i. Nominal density  $\geq 6.30 \text{ kg/m}^3$  and  $\leq 34 \text{ kg/m}^3$
    - ii. Binder content  $\leq 5\text{--}9\%$  depending on density range
  2. CSR Bradford Glasswool with natural binder
    - a. Nominal density  $\geq 6.64 \text{ kg/m}^3$  and  $\leq 23.2 \text{ kg/m}^3$
    - b. Binder content  $\leq 5.5\text{--}10\%$  depending on density range
  3. 75 Bradford Gold Batts R2.0 at  $17.3 \text{ kg/m}^3$  density.
  4. 90 Bradford Gold Batts R2.7 at  $33.1 \text{ kg/m}^3$  density.
7. CEMINTEL Surround<sup>®</sup> Wall Cladding System shall be used for its intended purpose. For further information on limited applications of the product, refer to the following Cemintel Surround<sup>®</sup> guides as relevant:
  - a) CEMINTEL SURROUND<sup>®</sup> EXTERNAL-Design & Installation Guide 02/2026
  - b) CEMINTEL SURROUND<sup>®</sup> SERIES – Internal Installation 01/2026.
8. CEMINTEL Surround<sup>®</sup> Wall Cladding System has been tested to the requirements of AS/NZS 4284:2018 in accordance with the NCC verification methods and has been determined to achieve compliance with F3P1 and H2P2 when installed as a pressure equalised system in applications where an external wall of the building also:
  - a) has a risk score of 20 or less determined in accordance with Table F3V1a or H2V1a, of the BCA, as appropriate; and
  - b) has a maximum Design Ultimate Limit State wind pressure of  $\pm 2.5 \text{ kPa}$  using the Cemintel soft air barrier system incorporating Enviroseal CW-IT wall wrap; and
  - c) has a maximum Design Serviceability Limit State wind pressure of  $+2.5 \text{ kPa}$  using a Cemintel Rigid Air Barrier system (Cemintel 6mm thick fibre cement RAB sheet); and
  - d) has a maximum Design Serviceability Limit State wind pressure of  $+1.19 \text{ kPa}$  and  $-1.79 \text{ kPa}$  using Enviroseal CW when not detailed as an air barrier. Bradford Enviroseal Plus and Aero are acceptable, but for low rise – classes 1, & 2-9 of Type C construction only.

Other wall wraps may also be used, provided they have equivalent or better strength properties than Enviroseal CW / CW-IT when determined in accordance with AS/NZS 4200.1:2017.

# Certificate of Conformity

9. CEMINTEL Surround<sup>®</sup> Wall Cladding System has been evaluated for use in all Australian wind zones up to and including N6 and Cyclonic C4 in accordance with AS 4055 and for ultimate wind pressures up to 7.0 kPa under AS/NZS 1170.2 including cyclonic zones when fixed to steel framing with Cemintel Rigid Air Barrier. Construction details and fixing must follow the relevant details contained within the System Engineering section of CEMINTEL SURROUND<sup>®</sup> EXTERNAL-Design & Installation Guide 02/2026.
10. CEMINTEL Surround<sup>®</sup> Wall Cladding System is not certified for either energy efficiency or acoustic performance.
11. CEMINTEL Surround<sup>®</sup> Wall Cladding System is suitable for use on buildings located in a designated Bushfire-Prone Area subject to a Bushfire Attack Level (BAL) up to and including BAL-29 when constructed in accordance with AS 3959:2018 (subject to state and territory variations) for a Class 1 building, a Class 2 building, a Class 3 building, a Class 9 building not exceeding BAL-12.5 determined in accordance with AS 3959:2018 and constructed to Specification 43, or a Class 10a building or deck immediately adjacent or connected to such a building or part.
12. In NSW, CEMINTEL Surround<sup>®</sup> Wall Cladding System is suitable for use on buildings located in a designated Bushfire-Prone Area:
  - a) For a Class 1 building, a Class 2 building, a Class 3 building, a Class 4 part of a building, or a Class 10a building or deck immediately adjacent or connected to such a building or part when constructed in accordance with AS 3959:2018 except as amended by Planning for Bush Fire Protection for BAL-29. Seek guidance from your appropriately qualified bushfire expert for additional consideration and assessment.
  - b) For a Class 9 buildings located in an area subject to a Bushfire Attack Level (BAL) not exceeding BAL-12.5 determined in accordance with AS 3959:2018 constructed in accordance with Specification 43.
13. In VIC, CEMINTEL Surround<sup>®</sup> Wall Cladding System is suitable for use on Class 9(a) healthcare buildings, Class 9(b) early childhood or school buildings, Class 9(c) residential care buildings or Class 4 parts of buildings associated with the preceding classifications that are in designated bushfire prone areas subject to a Bushfire Attack Level (BAL) not exceeding BAL-12.5 determined in accordance with AS 3959:2018 and constructed in accordance with Specification 43.

# Certificate of Conformity

14. All flashing including inter-storey junction must be metal flashing.
  
15. Products and systems to meet the requirements of each BAL when assessed against specifications in AS 3959:2018. All other building design specific requirements of G5D2, G5D3, G5D4 and Specification 43 including the design requirements of AS 3959:2018 must also be adhered to for compliance with G5D2, G5D3 and G5D4.

**Scope of certification:** The CodeMark Scheme is a building product certification scheme. The rules of the Scheme are available at the ABCB website [www.abcb.gov.au](http://www.abcb.gov.au). This Certificate of Conformity is to confirm that the relevant requirements of the Building Code of Australia (BCA) as claimed against have been met. The responsibility for the product performance and its fitness for the intended use remain with the certificate holder. The certification is not transferrable to a manufacturer not listed on Appendix A of this certificate.

**Disclaimer:** The Scheme Owner, Scheme Administrator and Scheme Accreditation Body do not make any representations, warranties or guarantees, and accept no legal liability whatsoever arising from or connected to, the accuracy, reliability, currency or completeness of any material contained within this certificate; and the Scheme Owner, Scheme Administrator and Scheme Accreditation Body disclaim to the extent permitted by law, all liability (including negligence) for claims of losses, expenses, damages and costs arising as a result of the use of the product(s) referred to in this certificate.

## APPENDIX A – PRODUCT TECHNICAL DATA


### A1 Type and intended use of product

Refer to Page 1 of this certificate.

### A2 Description of product

Refer to Page 1 of this certificate and the below diagrams.

Cemintel Surround is installed over an air barrier onto ExpressWall™ top hats using Surround rivets. This creates a pressure equalised cavity system which enhances weather resistance.

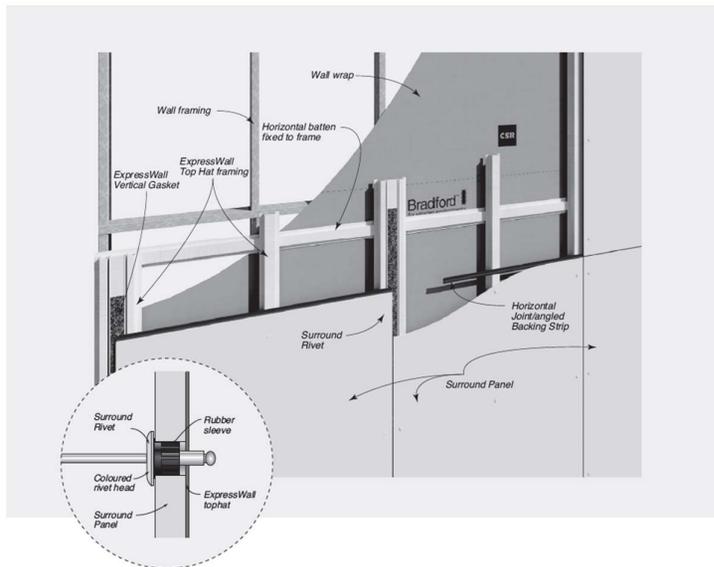

Typical Surround Wall System Cross Section for Steel Framing


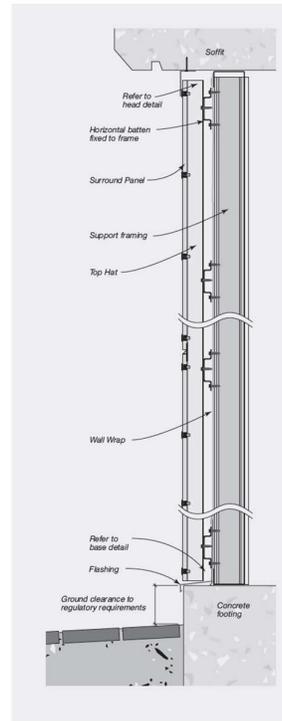


FIGURE 6.11 Typical Surround External Fire Rated Installation. Pressure Equalised Ventilated Cavity System



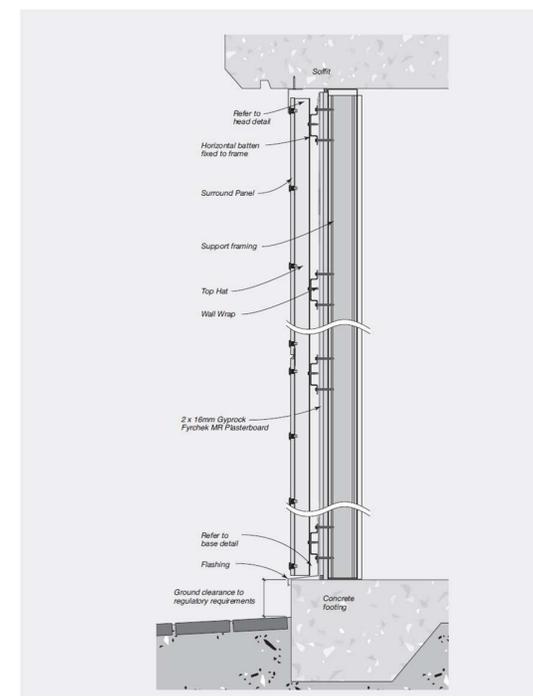

# Certificate of Conformity

## A3 Product specification

Below are some physical properties of fibre cement and system specifications.

### Product Specifications/System Solutions


Dimensional/Geometrical Characteristic	Specification (trimmed panel)	Manufacturing Tolerance	Relevant Standard
Panel Width	1200mm	+1.5mm / -1.5mm	AS/NZS 2908.2
Panel Length	3000mm*	+1.5mm / -1.5mm	AS/NZS 2908.2
Panel Thickness	8mm	+0.8mm / -0.8mm	AS/NZS 2908.2
Panel Mass (EMC)	15.7kg/m <sup>2</sup>		

Note: EMC - Equilibrium Moisture Content

# Certificate of Conformity


The following System Specification tables are extracts from Section F – External Wall Systems pages F13, F14, F28, and F29 of the GYPROCK® THE RED BOOK® 1 December 2025 Design guide publication.

F13

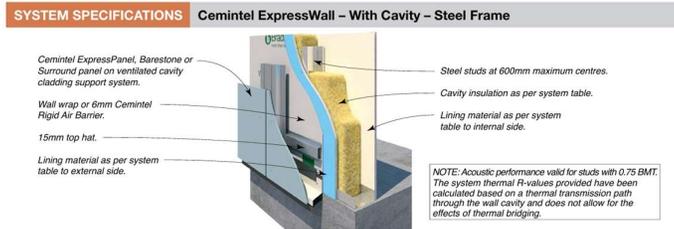

SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119					
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm		70		90	
			CAVITY INFILL (Refer to TABLE B6)	R <sub>w</sub> / R <sub>w</sub> +C <sub>tr</sub>	R <sub>t</sub> (sum) / R <sub>t</sub> (win)	R <sub>w</sub> / R <sub>w</sub> +C <sub>tr</sub>	R <sub>t</sub> (sum) / R <sub>t</sub> (win)	
- / - / -	CSR 5327	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	49/40	2.1/2.3	
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	50/41	2.6/2.8	
30/30/30 (from outside only) FC 12946	CSR 5332	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	48/39	2.1/2.2	49/40	2.3/2.4	
			(c) 90 Gold Batts R2.5	-	-	44/33	2.6/2.9	
		INTERNAL WALL SIDE	(d) 75 Gold Batts R2.0	42/31	2.1/2.3	43/32	2.3/2.5	
			Wall Thickness Excluding Cladding mm	133	153			
30/30/30 (from outside only) FC 12946	CSR 5340	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	48/38	2.2/2.4	
			(c) 90 Gold Batts R2.5	-	-	49/39	2.6/2.9	
		INTERNAL WALL SIDE	(d) 75 Gold Batts R2.0	47/37	2.1/2.2	48/38	2.3/2.5	
			Wall Thickness Excluding Cladding mm	143	163			
60/60/60 (from outside only) FC 12946	CSR 5342	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	44/33	2.2/2.4	
			(c) 90 Gold Batts R2.5	-	-	45/34	2.6/2.9	
		INTERNAL WALL SIDE	(d) 75 Gold Batts R2.0	43/32	2.1/2.3	44/33	2.3/2.5	
			Wall Thickness Excluding Cladding mm	146	166			
60/60/60 (from outside only) FC 12946	CSR 5343	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	46/35	2.2/2.4	
			(c) 90 Gold Batts R2.5	-	-	47/36	2.6/2.9	
		INTERNAL WALL SIDE	(d) 75 Gold Batts R2.0	45/34	2.1/2.3	46/35	2.3/2.5	
			Wall Thickness Excluding Cladding mm	146	166			

F14

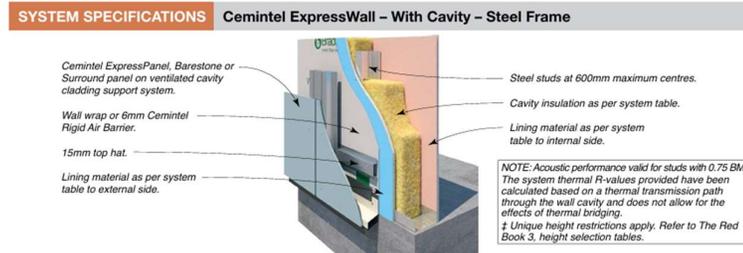


SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119					
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm		70		90	
			CAVITY INFILL (Refer to TABLE B6)	R <sub>w</sub> / R <sub>w</sub> +C <sub>tr</sub>	R <sub>t</sub> (sum) / R <sub>t</sub> (win)	R <sub>w</sub> / R <sub>w</sub> +C <sub>tr</sub>	R <sub>t</sub> (sum) / R <sub>t</sub> (win)	
60/60/60 - /90/90 (from both sides) FC 12946	CSR 5345	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	50/40	2.2/2.4	
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	51/41	2.6/2.9	
90/90/90 (from outside only) FC 12946	CSR 5346	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	48/37	2.2/2.4	
			(c) 90 Gold Batts R2.5	-	-	49/38	2.6/2.9	
		INTERNAL WALL SIDE	(d) 75 Gold Batts R2.0	49/39	2.2/2.3	50/40	2.4/2.6	
			Wall Thickness Excluding Cladding mm	152	172			
120/120/120 (from outside only) FC 12946	CSR 5347	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	49/38	2.2/2.4	
			(c) 90 Gold Batts R2.5	-	-	50/39	2.6/2.9	
		INTERNAL WALL SIDE	(d) 75 Gold Batts R2.0	48/37	2.2/2.4	49/38	2.4/2.6	
			Wall Thickness Excluding Cladding mm	162	182			
120/120/120 - /180/180‡ (from both sides) FC 12946	CSR 5349	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	55/46	2.2/2.4	
			(c) 90 Gold Batts R2.5	-	-	56/47	2.6/2.9	
		INTERNAL WALL SIDE	(d) 75 Gold Batts R2.0	54/45	2.3/2.5	55/46	2.6/2.7	
			Wall Thickness Excluding Cladding mm	184	204			

F28


F29

**SYSTEM SPECIFICATIONS Cemintel ExpressWall – With Cavity – Timber Frame**

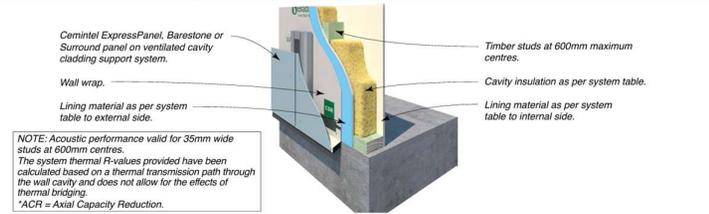

SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119				
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm				
			70	90			
			CAVITY INFILL (Refer to TABLE B6)	R <sub>w</sub> / R <sub>w+Ctr</sub>	R <sub>t(sum) / R<sub>t(win)</sub></sub>	R <sub>w</sub> / R <sub>w+Ctr</sub>	R <sub>t(sum) / R<sub>t(win)</sub></sub>
30/30/30 (from outside only) FC 12969	CSR 5851	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	46/36	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	47/37	2.6/2.9
			(d) 75 Gold Batts R2.0	45/35	2.1/2.2	46/36	2.3/2.5
			Wall Thickness Excluding Cladding mm	127		147	
30/30/30 (from both sides) FC 12969	CSR 5854	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	45/34	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	46/35	2.6/2.9
			(d) 75 Gold Batts R2.0	44/33	2.1/2.3	45/34	2.3/2.5
			Wall Thickness Excluding Cladding mm	131		151	
90/90/90 (from outside only) FC 12969	CSR 5857	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	46/35	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	47/36	2.6/2.9
			(d) 75 Gold Batts R2.0	45/34	2.2/2.3	46/35	2.4/2.6
			Wall Thickness Excluding Cladding mm	141		161	
60/60/60* (from outside only) *ACR Group 2 FC 12969	CSR 5860	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	43/32	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	44/33	2.6/2.9
			(d) 75 Gold Batts R2.0	42/31	2.1/2.3	43/32	2.3/2.5
			Wall Thickness Excluding Cladding mm	131		151	
60/60/60* (from outside only) *ACR Group 2 FC 12969	CSR 5862	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	44/33	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	45/34	2.6/2.9
			(d) 75 Gold Batts R2.0	43/32	2.1/2.3	44/33	2.3/2.5
			Wall Thickness Excluding Cladding mm	131		151	

**SYSTEM SPECIFICATIONS Cemintel ExpressWall – With Cavity – Timber Frame**

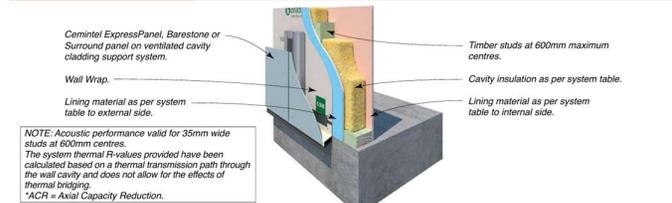

SYSTEM SPECIFICATION			ACOUSTIC REPORT: PKA-A119				
FRL Report	SYSTEM N°	WALL LININGS	STUD DEPTH mm				
			70	90			
			CAVITY INFILL (Refer to TABLE B6)	R <sub>w</sub> / R <sub>w+Ctr</sub>	R <sub>t(sum) / R<sub>t(win)</sub></sub>	R <sub>w</sub> / R <sub>w+Ctr</sub>	R <sub>t(sum) / R<sub>t(win)</sub></sub>
60/60/60 (from both sides) FC 12969	CSR 5865	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	47/37	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	48/38	2.6/2.9
			(d) 75 Gold Batts R2.0	46/36	2.2/2.3	47/37	2.4/2.6
			Wall Thickness Excluding Cladding mm	137		157	
60/60/60 (from both sides) 90/90/90* (from outside only) *ACR Group 2 FC 12969	CSR 5868	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	49/39	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	50/40	2.6/2.9
			(d) 75 Gold Batts R2.0	48/38	2.2/2.3	49/39	2.4/2.6
			Wall Thickness Excluding Cladding mm	143		163	
90/90/90* (from both sides) *ACR Group 3 FC 12969	CSR 5870	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	51/42	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	52/43	2.6/2.9
			(d) 75 Gold Batts R2.0	50/41	2.2/2.4	51/42	2.4/2.6
			Wall Thickness Excluding Cladding mm	153		173	
120/120/120 (from outside only) FC 12969	CSR 5872	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	47/36	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	48/37	2.6/2.9
			(d) 75 Gold Batts R2.0	46/35	2.2/2.4	47/36	2.4/2.6
			Wall Thickness Excluding Cladding mm	147		167	
120/120/120 (from both sides) FC 12969	CSR 5874	EXTERNAL WALL SIDE	(b) 90 Gold Batts R2.0	-	-	52/43	2.2/2.4
		INTERNAL WALL SIDE	(c) 90 Gold Batts R2.5	-	-	53/44	2.6/2.9
			(d) 75 Gold Batts R2.0	51/42	2.3/2.5	52/43	2.6/2.7
			Wall Thickness Excluding Cladding mm	169		189	

## **A4 Manufacturer and manufacturing plant(s)**

## **A5 Installation requirements**

Refer to Page 3 of this certificate and the following:

- CEMINTEL SURROUND<sup>®</sup> EXTERNAL-Design & Installation Guide 02/2026
- CEMINTEL SURROUND<sup>®</sup> SERIES – Internal Installation 01/2026

## **A6 Other relevant technical data**

- Technical Datasheets for Bradford Thermosteel<sup>®</sup> Wall Wrap XP, Bradford Thermosteel<sup>®</sup> Wall Wrap, Bradford Thermosteel<sup>®</sup> Firespec, Bradford Enviroseal CW/CW-IT Wall Wrap, Bradford Enviroseal Aero Wall wrap, and Bradford Enviroseal Plus Wall wrap with nominal thickness <1.0mm for all products.
- Technical Datasheet for Bradford Acoustigard partition rolls.
- Technical Datasheet for Bradford Acoustigard Batts.

## APPENDIX B – EVALUATION STATEMENTS

### B1 Evaluation methods

The system has been assessed as complying with the identified Performance Requirements of the NCC 2022 Amendt 2 BCA Volumes 1 and 2. This involved a review of product specifications, test reports, installation manuals, and associated documentation.

1. **Structural assessment:**

- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Cyclone Testing Station, James Cook University (NATA accreditation No. 14937)
- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(e) – A report from a professional engineer (David Beneke Consulting).

2. **Weatherproofing assessment:**

- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Ian Bennie and Associates (NATA accreditation No. 2371)
- Volumes 1 & 2 – A2G2(2)(a)/A5G3(1)(e) – A report from an appropriately qualified person (XAVIER KNIGHT).

3. **Fire Resistance assessment:**

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – An assessment report issued by an Accredited testing Laboratory – BRANZ Ltd (IANZ accreditation No. 37).

4. **Non-Combustibility assessment:**

A. **Surround Fibre Cement (General Concessions)**

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(f) – Another form of documentary evidence – by exemption/product specification.

B. **Sarking-type material**

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Insulation Research Laboratory (NATA accreditation No. 993).
- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – AWTA Product Testing (NATA accreditation No. 1356).

C. **Insulation material**

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(d) – A report issued by an Accredited testing Laboratory – Insulation Research Laboratory (NATA accreditation No. 993).
- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(e) – An assessment report from an appropriately qualified person – Warringtonfire Australia Pty Ltd.

5. **Fire Hazard Properties assessment:**

- Volume 1 – A2G3(2)(a)/A5G3(1)(e) – An assessment report from an appropriately qualified person – Warringtonfire Australia Pty Ltd.

6. **Construction in Bushfire Prone Areas assessment:**

- Volumes 1 & 2 – A2G3(2)(a)/A5G3(1)(f) – Another form of documentary evidence (assessment against specifications in the referenced document – AS 3959:2018).

## B2 Reports

Evaluation methods	Related Supporting Evidence as listed below
Structural Assessment	Numbers 1 – 3
Weatherproofing Assessment	Numbers 4 – 5
Fire Resistance assessment	Numbers 6– 7
Non-Combustibility	Numbers 8 – 14
Fire Hazard Properties assessment	Number 15
Resistance to Bushfire Construction assessment	Number 16

## Structure

- Cyclone Testing Station, James Cook University, Connection Testing, Cyclic Simulated Wind Load Strength Testing, and Assessment of the Cyclic Wind Load Capacity of CSR Cemintel Creative Façade System, Report No. TS1055 Revision A (Dated: 26 April 2017).** *This document contains the test results of a Cemintel Creative Façade (8mm & 9mm nominal thickness) and connection testing for resistance to simulated cyclic wind load, carried out in accordance with AS 4040.3.*
- David Beneke Consulting, Engineering Report for Certification of CSR Cemintel Surround Façade System, Report No. 2013-28-LO-215 Revision 7 (Dated 03 Dec 2024).** *This document certifies the maximum top hat spans and spacings of Surround façade system with Surround panels in accordance with normal engineering practice and principals, test methods and the relevant Australian Standards.*

## Weatherproofing

- Ian Bennie and Associates, Test Report for Air Infiltration, Water Penetration and Structural of Cemintel Creative Façade System, Report No. 2016-108-S1-R3 (updated 31 October 2023).** *This document contains the test results of the Cemintel Creative Façade System for Structural SLS, Air Infiltration, Water Penetration, and Structural ULS carried out in accordance with AS/NZS 4284:2008.*
- Ian Bennie and Associates, Test Report for Ultimate Load Capacity, Report No. 2016-066-S2 (Dated 8 November 2016).** *This document contains the test results of Bradford Envirosal ProctorWrap CW-IT without external cladding to determine the ultimate load capacity (Structural ULS) of the wrap alone carried out in accordance with AS/NZS 4284:2008.*



# Certificate of Conformity

5. **XAVIER KNIGHT, Weatherproofing Assessment for Cemintel Expressed Joint External Wall Systems (Surround, Barestone, ExpressPanel), XK220912 Revision 04 (Dated 02 February 2026).**

*This document confirms the compliance of this product with AS 4284:2008, based on the test results of Report Nos. 2016-108-S1 & 2016-066-S2, by Ian Bennie and Associates.*

## Fire Resistance

6. **BRANZ, Assessment Report for Fire Resistance of CSR Steel Framed Wall Systems, Report No. FC12946-01-13 Issue 13 (Dated: 06 May 2025).**

*This document contains the fire assessment results of the CSR steel framed system for resistance to fire, carried out in accordance with AS 1530.4:2014.*

7. **BRANZ, Assessment Report for Fire Resistance of CSR Timber Framed Walls, Report No. FC12969-01-05 Issue 5 (Dated: 08 May 2025).**

*This document contains the fire assessment results of the CSR timber framed system for resistance to fire, carried out in accordance with AS 1530.4:2014.*

## Non-Combustibility

### A. Sarking-type material

8. **AWTA Product Testing, Test Report for Flammability Index of Enviroseal ProctorWrap (RW) Wall Wrap, Test No. 22-001559 (Dated: 25 May 2022).**

*This test report provides the test results of testing ProctorWrap residential wall (RW) to AS 1530.2:1993 and returned a result of Flammability Index 1.*

9. **AWTA Product Testing, Test Report for Flammability Index of Enviroseal ProctorWrap (CW) Wall Wrap, Test No. 22-001560 (Dated: 20 May 2022).**

*This test report provides the test results of testing ProctorWrap commercial wall (CW) to AS 1530.2:1993 and returned a result of Flammability Index 1.*

10. **AWTA Product Testing, Test Report for Flammability Index of Enviroseal (RW Plus) Wall Wrap, Test No. 21-002455 (Dated: 28 May 2021).**

*This test report provides the test results of testing Enviroseal (RW Plus) to AS 1530.2:1993 and returned a result of Flammability Index 1.*

11. **CSR Insulation Research Laboratory , Combustibility test for Enviorseal Aero, Report No. NR-22202A (Dated 21 Nov 2025).**

*This test report provides the test results of testing Enviroseal Aero(Grey/white laminate) to AS 1530.2:1993 and returned a result of Flammability Index 1.*

## **B. Insulation**

### **12. Warringtonfire, Assessment Report for CSR Bradford Glasswool insulation products, Report No. FAS220051 Revision 1.3 (Dated: 21 June 2024).**

*This report documents the findings of the assessment undertaken to determine the expected fire hazard properties of CSR Bradford glasswool insulation products in accordance with AS 1530.1:1994.(R2016).*

### **13. CSR Insulation Research Laboratory, Combustibility Test of CSR Bradford Gold, Report No. NR-20004 (Dated: 11 September 2020).**

*This report contains the results of testing 75mm CSR Bradford Gold<sup>®</sup> R2.0 Wall Batts (mean density 17.3kg/m<sup>3</sup>) to EN ISO1182/AS 1530.1 and determined the product was not deemed combustible when tested to the requirements of AS 1530.1:1994.*

### **14. CSR Insulation Research Laboratory, Combustibility Test of CSR Bradford Gold, Report No. NR-22112 (Dated: 28 July 2022).**

*This report contains the results of testing 90mm CSR Bradford Gold<sup>®</sup> R2.7 Wall Batts (mean density 33.11kg/m<sup>3</sup>) and determined the product was not deemed combustible when tested to the requirements of AS 1530.1:1994*

## **Fire Hazard Properties**

### **15. Warringtonfire, Assessment Report for Group Number and Smoke Growth Rate Index (SMOGRARC), Report No. WF- 45759 Revision 14.3 (Dated 17<sup>th</sup> September 2025).**

*This report shows the assessment undertaken to determine the likely fire hazard properties of the CSR wall and ceiling lining products and determined CSR plasterboard products are likely to achieve Group 1 classification and  $SMOGR_{ARC} \leq 0.5m^2/s^2 \times 1000$  and CSR Cemintel fibre cement panels (including 8mm Surround) are likely to achieve Group 1 classification and  $SMOGR_{ARC} \leq 0.2m^2s^{-2} \times 1000$  if tested in accordance with AS ISO 9705:2003 (R2016) and assessed in accordance with AS5637.1:2015.*

## **Resistance to Bushfire Attack**

### **16. Cemintel<sup>®</sup> Product Guide for Bushfire-Prone Areas (dated November 2023).**

*This guide provides information on Cemintel<sup>®</sup> wall cladding products and systems to meet the requirements of each BAL when assessed against specifications in AS 3959:2018.*